





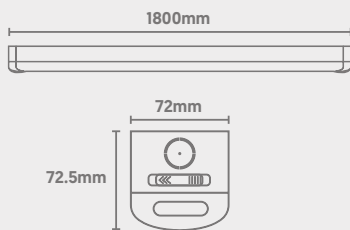
Surface & Suspended

QPac Linear Batten

CODE: QPAC-40-1800NW/ME

-  Easy-Release Diffuser
-  BESA Mounting Points
-  Conduit Side Entry
-  Metal Housing

Dimensions



Microwave Sensor
Info on Following Pages




| Power | Efficacy | Output | Kelvin |
|--------------------|----------|--------------------------|--------|
| 40W [Emergency 3W] | 120Lm/cW | 4800Lm [Emergency 360Lm] | 4000K |

Technical

| | |
|------------------------|--|
| Input Voltage | AC 220-240V |
| Beam Spread | 120° |
| Colour Rendering Index | >80 |
| Power Factor | >0.9 |
| Operating Temp. | -20 to +40°C |
| Materials | Metal & Polycarbonate |
| IP Rating | IP20 |
| Dimmable | Microwave Sensor |
| Dimensions | 1800mm x 72.5mm x 72mm |
| Weight | 2.64kg |
| MacAdam Step | <3 |
| Emergency Output | 3 Hours [3W] |
| Lifetime | 50,000 hours, L70-B10 [Ta 25 °C] |
| CE Standards | EN60598-1, EN62493, EN55015, EN61547, EN61000-3-2, EN61000-3-3, EN62722-1, EN62722-2-1 and EN50581 |
| CE Directives | LVD, EMC, ERP & RoHS |

A ↑ G E Light Source Energy Rating



Photometric Data

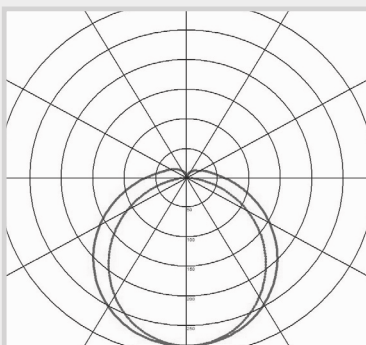

QPac

Microwave Sensor

Dimensions

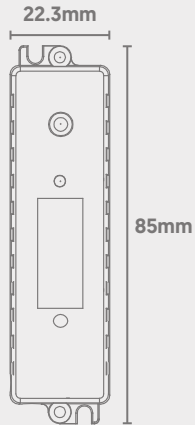

Main Specifications

| | |
|----------------------|------------------------|
| Solution Type | Rod Antenna |
| Input | DC 12V |
| Dimmable | 0-10V |
| Controls | DIP Switch |
| Dimensions | 85mm x 22.3mm x 24.5mm |

Technical


| | |
|-------------------------------|-----------------------------------|
| Operating Voltage | DC 12V |
| Operating Current | <25mA |
| Stand-By Power | <0.5W |
| Mounting Height | 2.5m to 4.5m (8.2ft. to 14.76ft.) |
| Detection Height | 4m to 10m (13.12ft. to 32.8ft.) |
| Microwave Power | <0.3mW |
| Microwave Frequency | 5.8GHz±75MHz |
| Detection Area | 50% / 100% |
| Hold-Time | 5s / 30s / 1min / 10min |
| Daylight Threshold | 2Lx / 10Lx / 50Lx / Disabled |
| Stand-By Period | 0s / 30s / 20min / +∞ |
| Stand-By Dimming Level | 10% / 20% / 30% / 50% |
| Motion Detection | -0.5 to 1.5m/s |
| IP Rating | IP20 |

QPac


Microwave Sensor

Function Overview


On/Off Function (Stand-By Period is 0s)



1) If ambient light is at a sufficient level, the light will remain off even if motion is detected.




2) If ambient light is not sufficient, the light will switch on when motion is detected by the sensor.

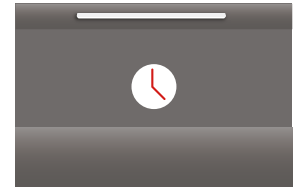

3) After hold-time elapses, the sensor will switch off the light if no motion is detected.


Daylight Threshold Set To 'Disabled'



1) If motion is detected, the light will switch on.




2) The sensor keeps the light on for the set hold time after the object leaves the detection area.

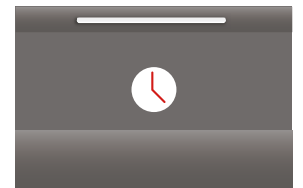

3) After hold-time elapses, the sensor will switch the light back off.

Corridor Function (2 Level Dimming)



1) If ambient light is at a sufficient level, the light will remain off even if motion is detected.



2) If ambient light is not sufficient, the light will switch on when motion is detected by the sensor.



3) After hold-time elapses, the sensor will switch back to the preset low light level if no motion is detected.




4) After stand-by period elapses, the sensor will switch the light off if no motion is detected.

QPac


Microwave Sensor

Wiring Diagram

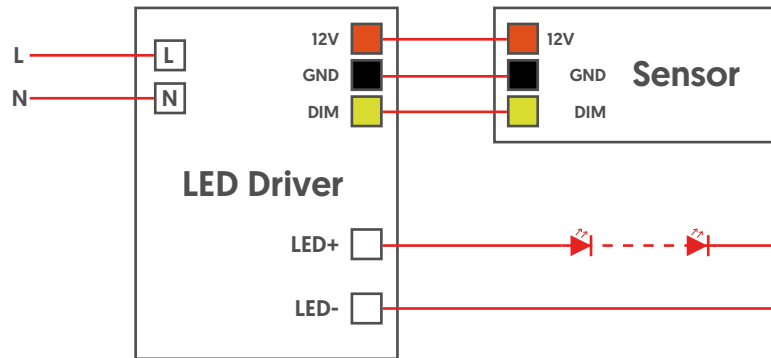

+12V
GND
OUT

Detection Patterns

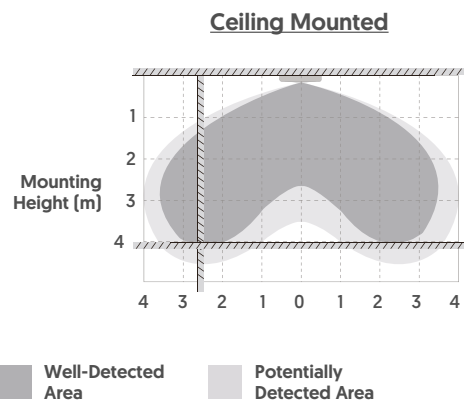

The highest mounting height is ideally 4.5m for optimal detection (see dark grey areas). This figure indicates 100% sensitivity.

DIP Switch Settings



SWITCH UP

SWITCH DOWN

Stand-By Dimming Level

| | | |
|----------------------------------|----------------------------------|-----|
| <input checked="" type="radio"/> | <input checked="" type="radio"/> | 10% |
| <input checked="" type="radio"/> | <input type="radio"/> | 20% |
| <input type="radio"/> | <input checked="" type="radio"/> | 30% |
| <input type="radio"/> | <input type="radio"/> | 50% |

The dimming level of low output during the stand-by period.

Stand-By Period

| | | |
|----------------------------------|----------------------------------|-------|
| <input checked="" type="radio"/> | <input checked="" type="radio"/> | 0s |
| <input checked="" type="radio"/> | <input type="radio"/> | 30s |
| <input type="radio"/> | <input checked="" type="radio"/> | 20min |
| <input type="radio"/> | <input type="radio"/> | +∞ |

The period that the light stays at lowest output before it completely switches off. When the preset is set to '+∞', the light will always stay at low output when no motion is detected and will not turn off.

Daylight Threshold

| | | |
|----------------------------------|----------------------------------|---------|
| <input checked="" type="radio"/> | <input checked="" type="radio"/> | Disable |
| <input checked="" type="radio"/> | <input type="radio"/> | 30s |
| <input type="radio"/> | <input checked="" type="radio"/> | 1min |
| <input type="radio"/> | <input type="radio"/> | 10min |

The level of ambient brightness threshold. When ambient brightness is below the preset lux amount, the sensor will operate. If set to 'disabled', the sensor will operate on motion detection regardless of ambient brightness levels.

Hold Time

| | | |
|----------------------------------|----------------------------------|-------|
| <input checked="" type="radio"/> | <input checked="" type="radio"/> | 5s |
| <input checked="" type="radio"/> | <input type="radio"/> | 30s |
| <input type="radio"/> | <input checked="" type="radio"/> | 1min |
| <input type="radio"/> | <input type="radio"/> | 10min |

The period of time that the light stays at 100% brightness once the detected object/person leaves the detection area.

Detection Area

| | |
|----------------------------------|------|
| <input checked="" type="radio"/> | 100% |
| <input type="radio"/> | 50% |

In the specified detection area, movement will trigger the sensor. 100% detection is also known as 'strong sensitivity'.

QPac

Microwave Sensor

Important Notes

- 1) The sensor should only be installed by a qualified electrician.
- 2) Power must be off before any installation, wiring, or changing of DIP switch settings takes place.
- 3) Microwaves cannot penetrate metal. Do not place the sensor within an enclosed metal fitting or half-closed metal fitting. Metal or glass (thicker than 20mm) should not cover the sensor, as this will affect performance.
- 4) Vibration signals may be picked up as moving signals, therefore triggering the sensor. Avoid placing the sensor near objects that vibrate regularly, such as metal equipment, pipes, air conditioning outlets, exhaust vents, smoke exhaust machine ports, shaking fans etc.
- 5) Use for indoor installations only, due to hazards such as rain or wind.
- 6) Wiring must be strictly in accordance to the diagram provided to avoid short circuit.
- 7) Testing should be conducted on sunny days with no lampshade in order to get an accurate lux value reading.